


Isabella County CMURC Mt. Pleasant SmartZone

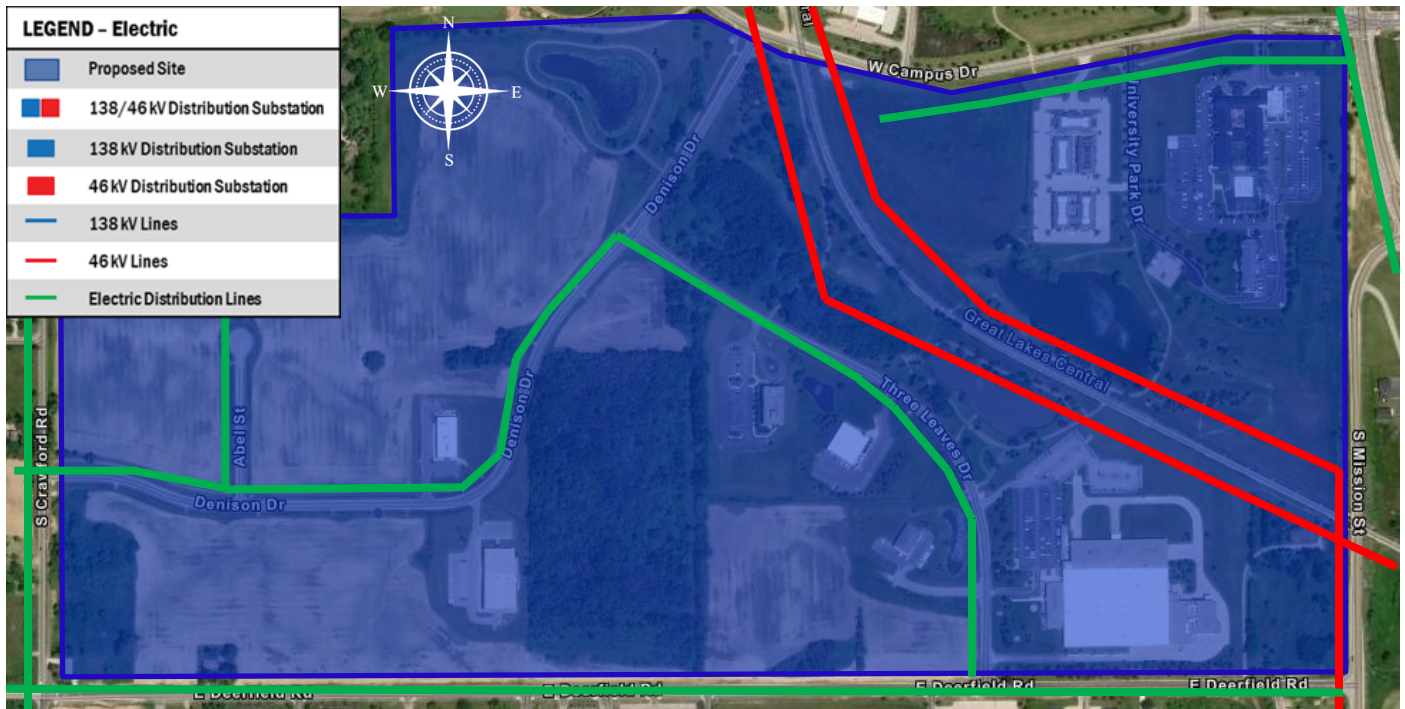

All existing facility locations are approximate and are not to be used for construction purposes. Always contact MISS DIG 811 before you dig.

Electric Site Benefits

- **Distribution System**
 - Predicted reliability of up to 99.896% for 4.8/8.32kV system.
 - The distribution system is located onsite/adjacent to the site.
 - Currently rated for a maximum electric demand of 2.25 MW. Additional capacity may be available with system upgrades.
- **46 kV System**
 - Predicted reliability of up to 99.998%. The predicted reliability percentage represents the estimated amount of time the facility is in service.
 - The 46kV system is located onsite/adjacent to the site.
 - Facilities would be sized to meet the energy needs of the customer and available system capacity determined at the time of a specific request.
- **138 kV System**
 - Predicted reliability of up to 99.998%. The predicted reliability percentage represents the estimated amount of time the facility is in service.
 - The 138kV system is located approximately 2 miles away.
 - Facilities would be sized to meet the energy needs of the customer and available system capacity determined at the time of a specific request.

For additional information

Michele Eaton, Economic Development Manager | 810-760-3497 | michele.eaton@cmsenergy.com